



Thermal Storage in Smart PCM Walls:

An enhanced and controlled discharge power by forced convection



Haute école d'ingénierie et d'architecture Fribourg
Hochschule für Technik und Architektur Freiburg

Presented by Antoine Boss

Authors: J. Robadey, R. Wegmüller, A. Chiriatti, G. Magnin, E.L. Niederhauser

15. Symposium Energieinnovation, February 16th 2018, TU Graz, Austria

Outline

- Description of the active PCM concept
- Testbed
 - Set-up
 - Measurements
 - Simulations

} concept validation
- Simulations of a reference building
 - PCM of 23°C and 26°C with day and night loading
 - Active and passive PCM
- Conclusion and outlook

Active PCM concept

- Electrical battery can be charged and discharged at every moment

- Standard PCM (Phase Change Material):

- can be loaded on demand (heating)
- discharged as soon as $T_{\text{int}} < T_c$




**Storage management
not possible**

- **NEW CONCEPT**
with on demand activation of the PCM discharge

- **Solution**

Charge	→	Heating an insulated PCM
Storage	→	PCM remains insulated
Discharge	→	Ventilation of the PCM

Concept of a ventilated PCM wall

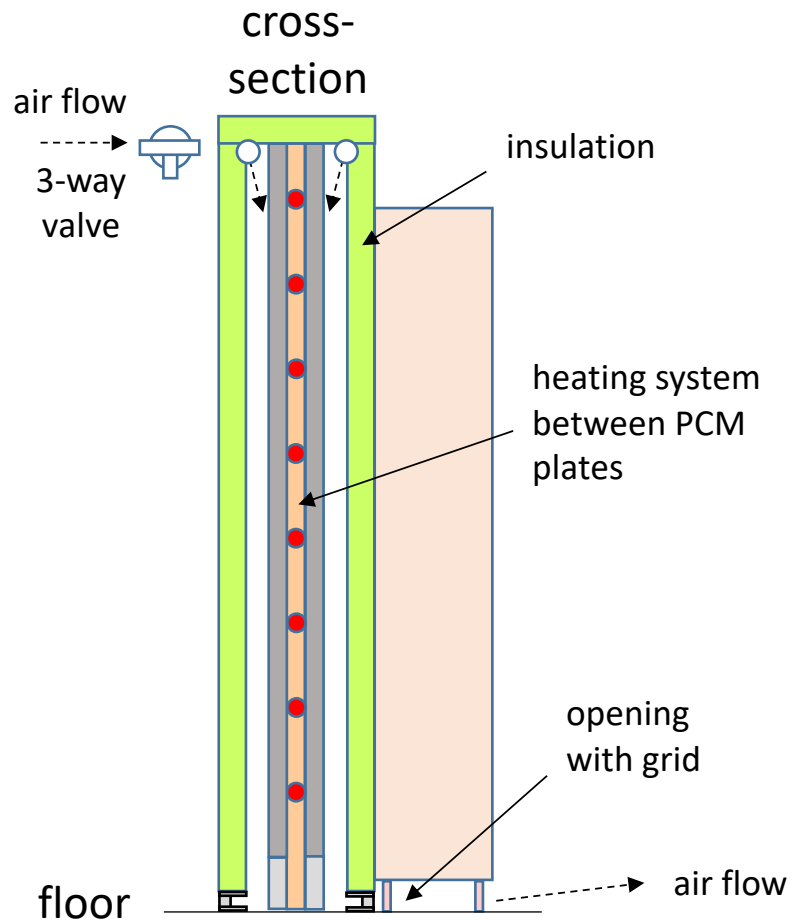

- Heating with a water circuit
- Discharging with an air flow
- PCM:
 - micronal encapsulated paraffin with $T_c = 23/26^\circ\text{C}$



- in «Lehmorange» plates
- Advantage:
 - discharge can be controlled
 - wall can be furnished


Testbed: PCM wall in the middle of two rooms

heating system

PCM-Plate





Active discharge

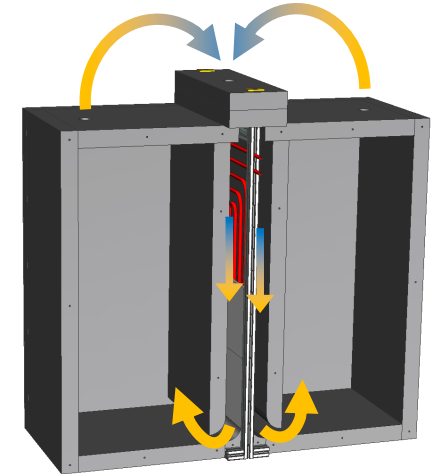


Smart PCM Walls : Simulation results

External and box temperatures

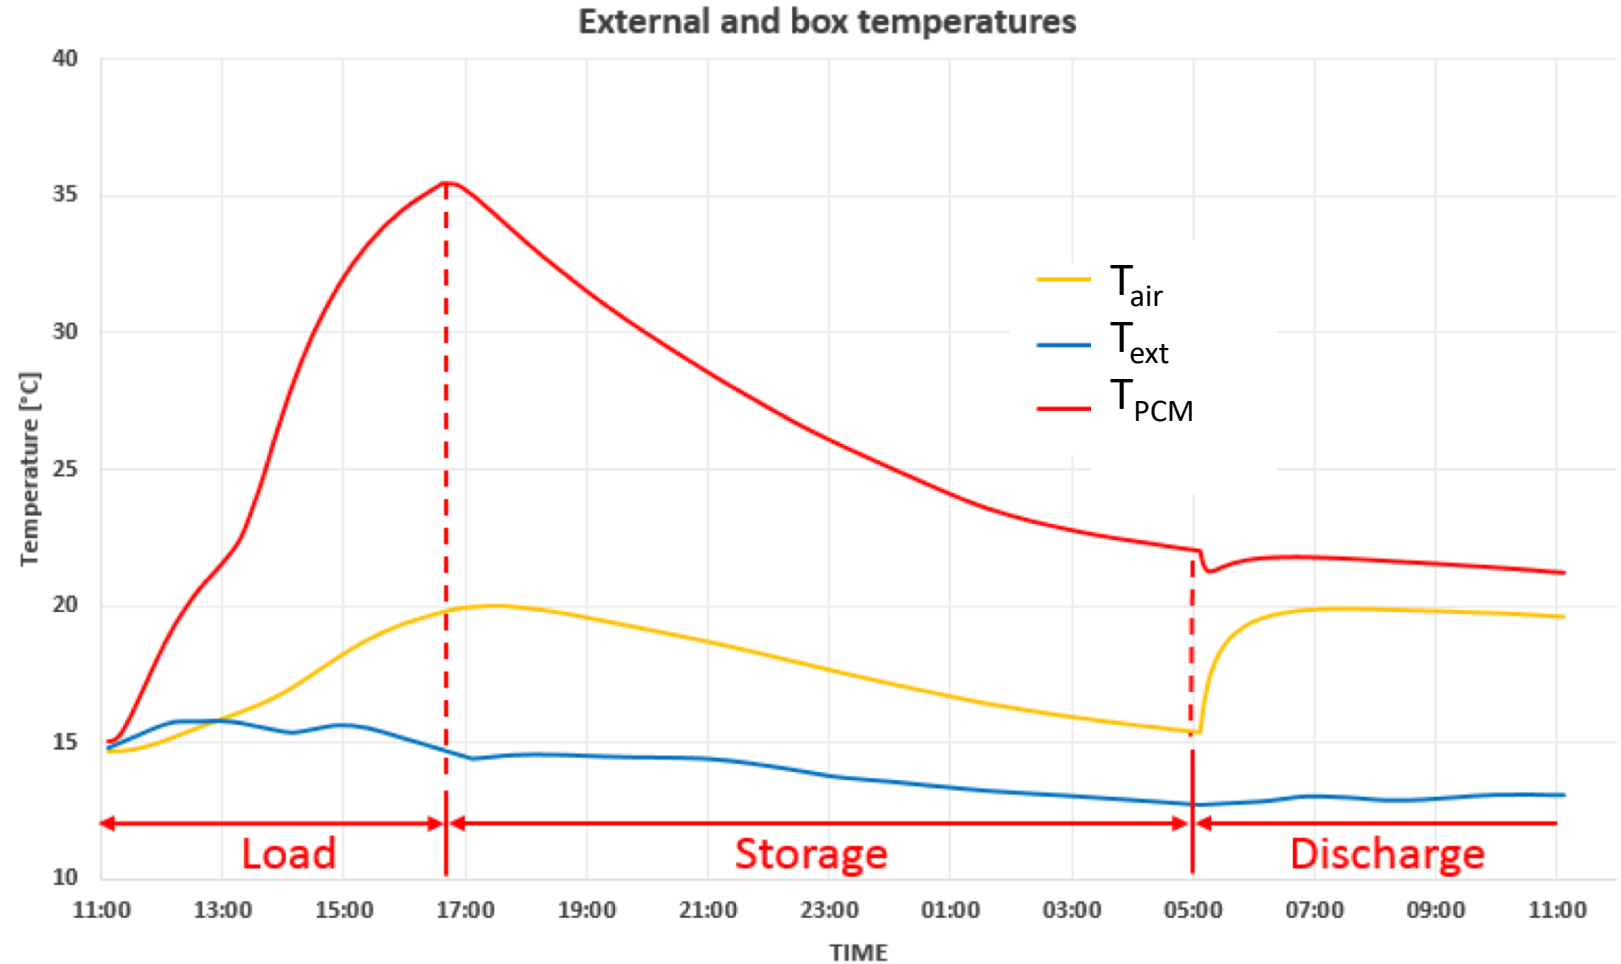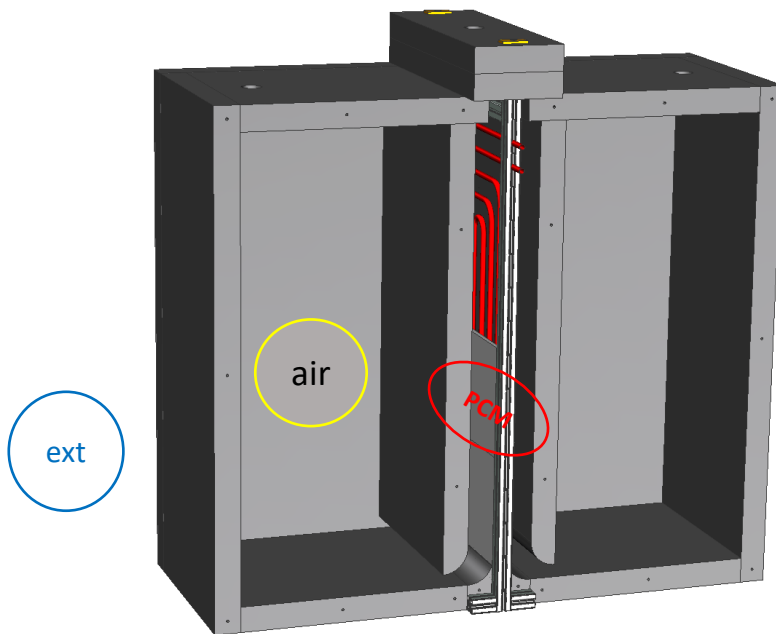


Smart PCM Walls : Comparison Measures-Simulations

Two days cycle

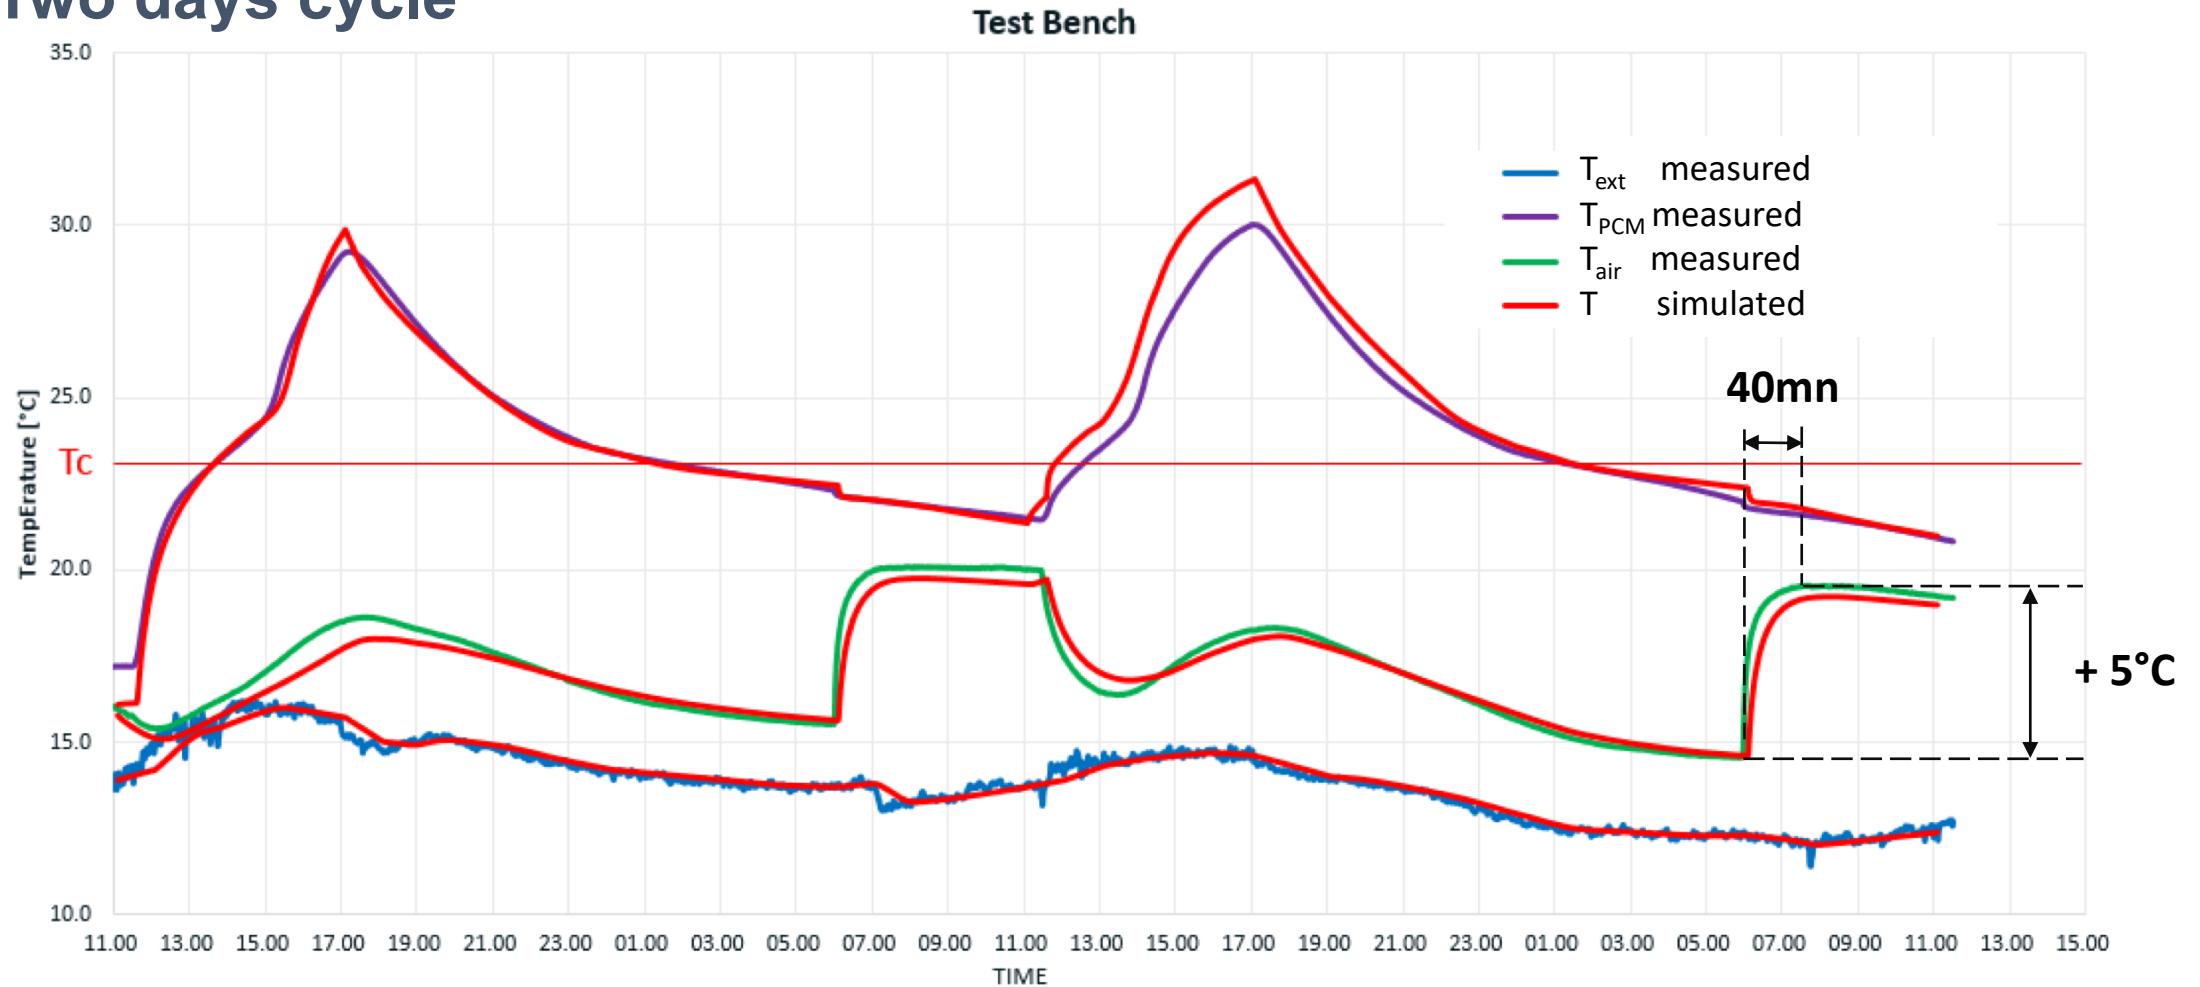

Simulations of a reference building

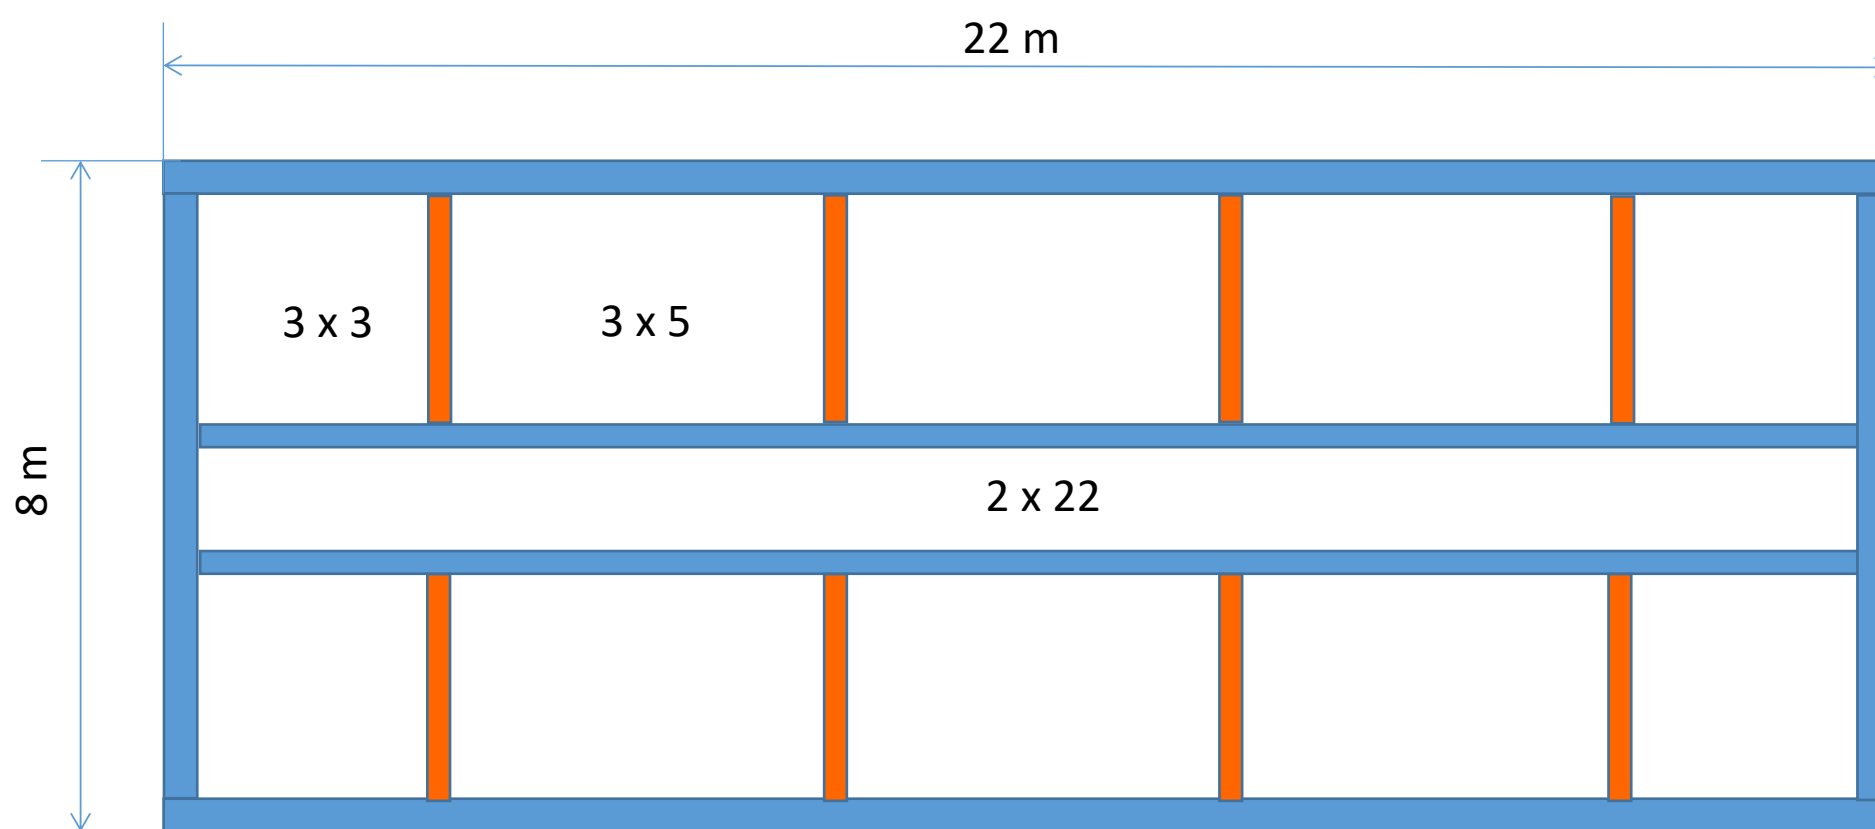



- PCM walls
- bearing walls

Height 3m per floor
Building has 2 floors
Total volume: 1'000 m³

administrative building
(not occupied at night
and during week-ends)



Heating process with PCM walls

- **Goal:** increase the building autonomy and assure comfort temperature during building occupancy
- **4 states:**
 - **Loading:** Heat pump on without ventilation
 - **Storage:** no heating and no ventilation
 - **Discharge:** Ventilation (heat pump off)
 - **Heating:** Heat pump on with ventilation

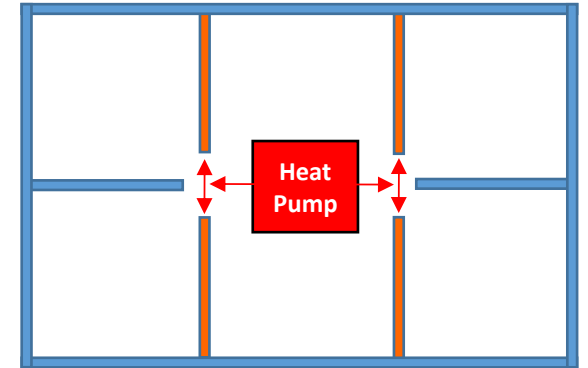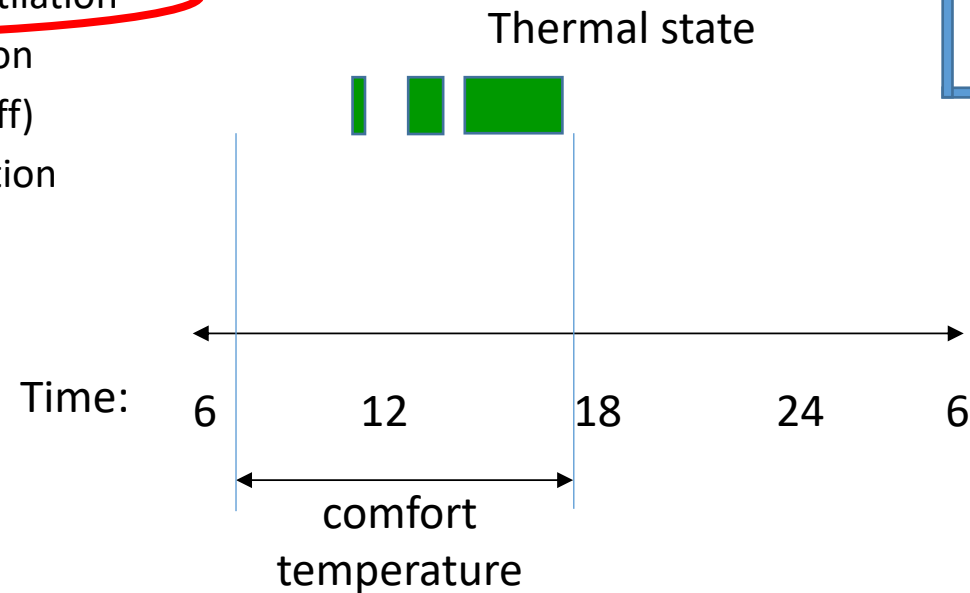



Heating process with PCM walls

- **Goal:** increase the building autonomy and assure comfort temperature during building occupancy
- **4 states:**
 - **Loading:** Heat pump on without ventilation
 - **Storage:** no heating and no ventilation
 - **Discharge:** Ventilation (heat pump off)
 - **Heating:** Heat pump on with ventilation

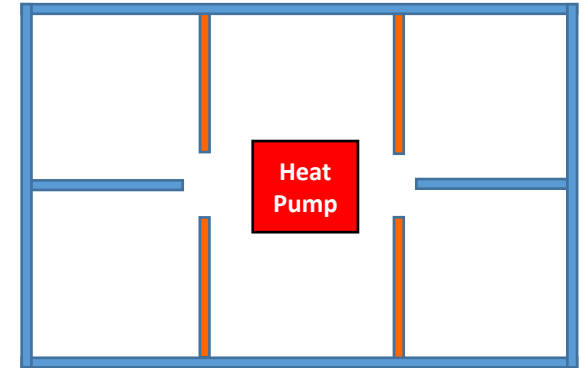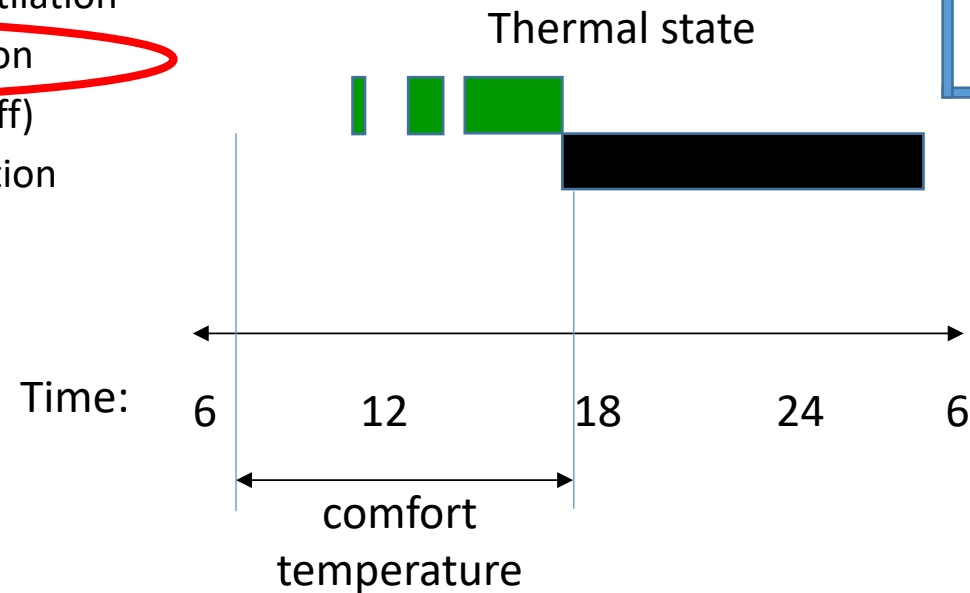



Heating process with PCM walls

- **Goal:** increase the building autonomy and assure comfort temperature during building occupancy
- **4 states:**
 - **Loading:** Heat pump on without ventilation
 - **Storage:** no heating and no ventilation
 - **Discharge:** Ventilation (heat pump off)
 - **Heating:** Heat pump on with ventilation

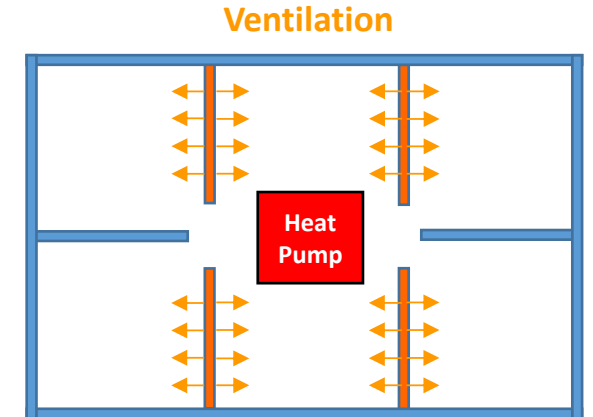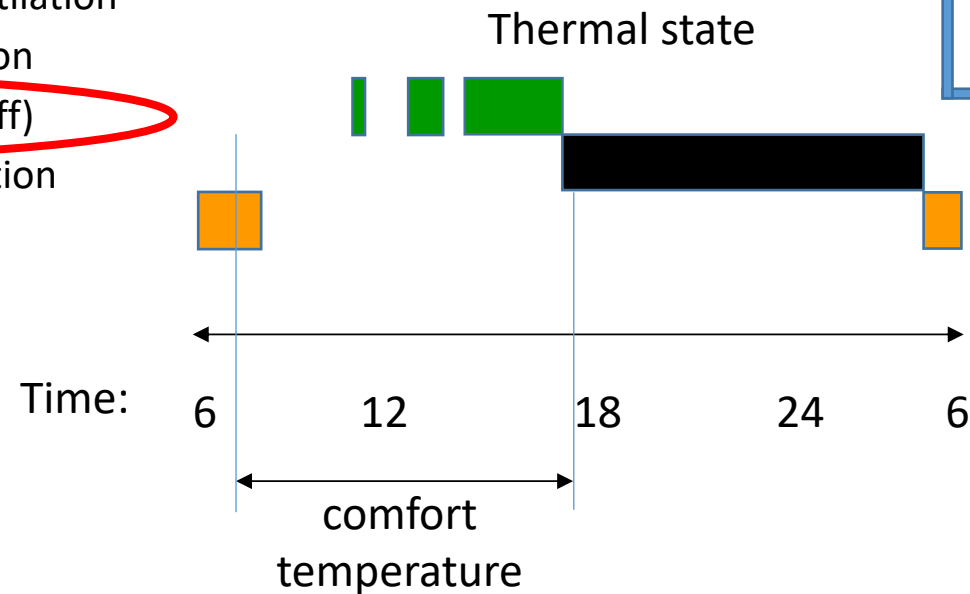

Heating process with PCM walls

- **Goal:** increase the building autonomy and assure comfort temperature during building occupancy
- **4 states:**
 - **Loading:** Heat pump on without ventilation
 - **Storage:** no heating and no ventilation
 - **Discharge:** Ventilation (heat pump off)
 - **Heating:** Heat pump on with ventilation

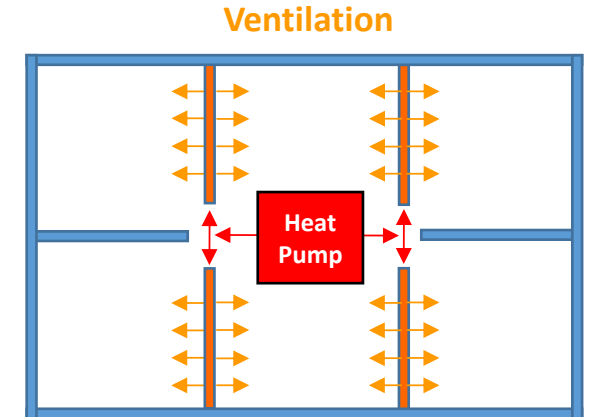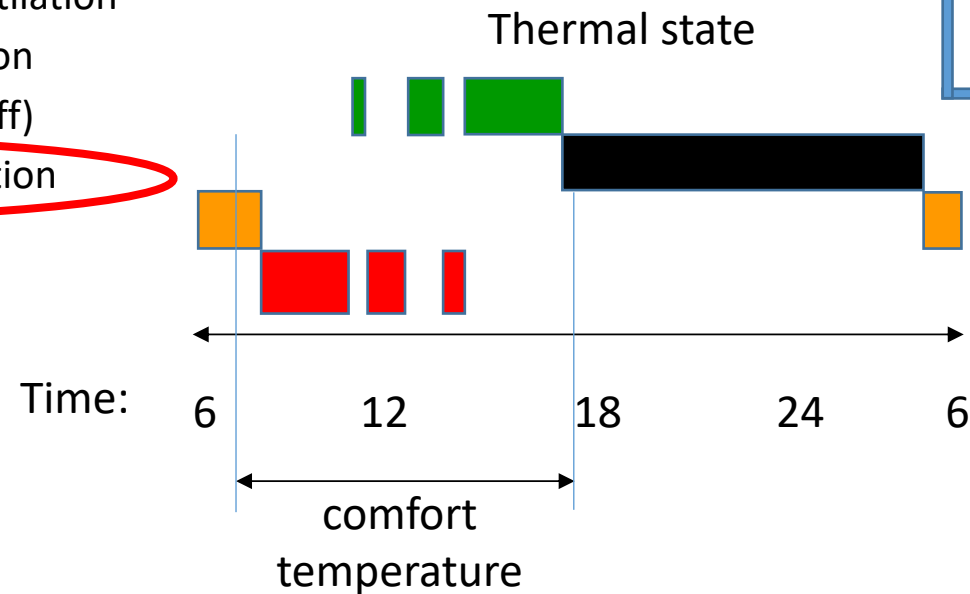

Simplified simulations

- T_{ext} constant the whole day all around the building
 - Solar heating inside the building and wind effect are neglected
 - U-value = 0.15 W/m²K for the building envelope
 - Comfort temperature of about **20.5°C** between **06h and 17h30**
 - Air renewal: 0.5 Vol/hour from 7h to 18h with 90% heat recovery
 - **PCM loaded with 12kW** either during the day or night
 - day: from 9h30 to 16h
 - night: before 6h
- } but no more than 6h30
- Simulation performed from **6h to 6h the next day** with goals:
 - recover the **same temperatures**: T_{int} , T_{concrete} , T_{PCM} and the **same PCM loading**
 - in case of insufficient heating time → study the drops of T_{int} , T_{concrete} , T_{PCM} and PCM loading

Day loading:


PV panels → Heat pump: 12KW → PCM



Day loading simulation results

$$T_c = 23^\circ\text{C}$$

— $T_{\text{PCM board}}$
— $T_{\text{air int}}$


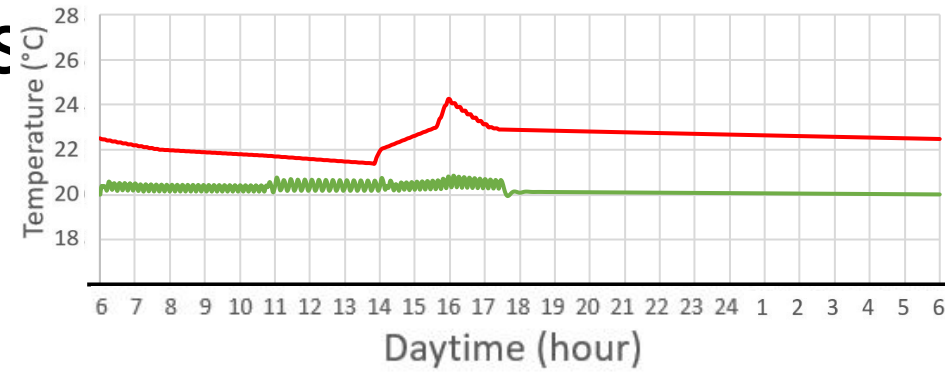


Day loading simulation result

— $T_{\text{PCM board}}$
— $T_{\text{air int}}$

$T_c = 23^\circ\text{C}$

$T_c = 26^\circ\text{C}$

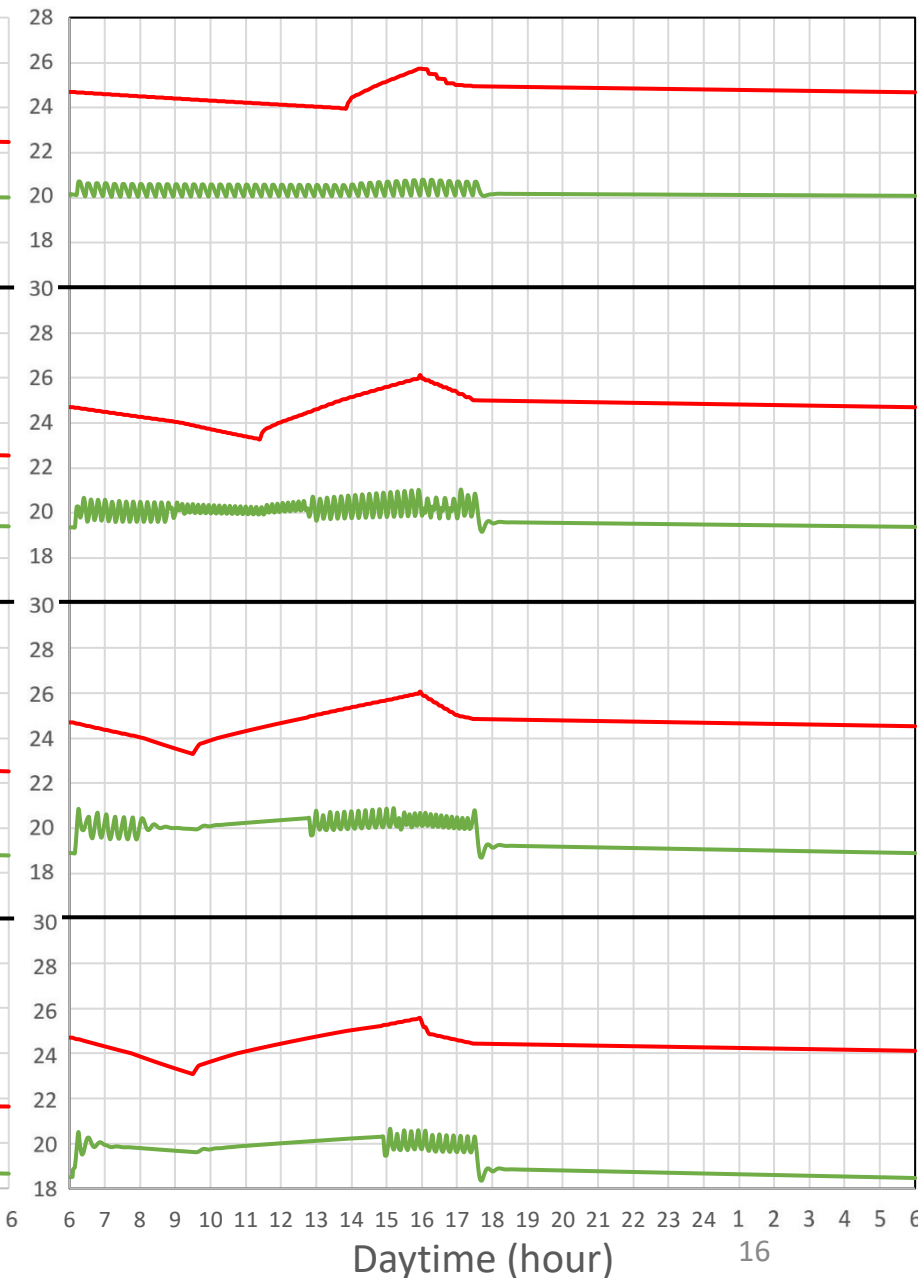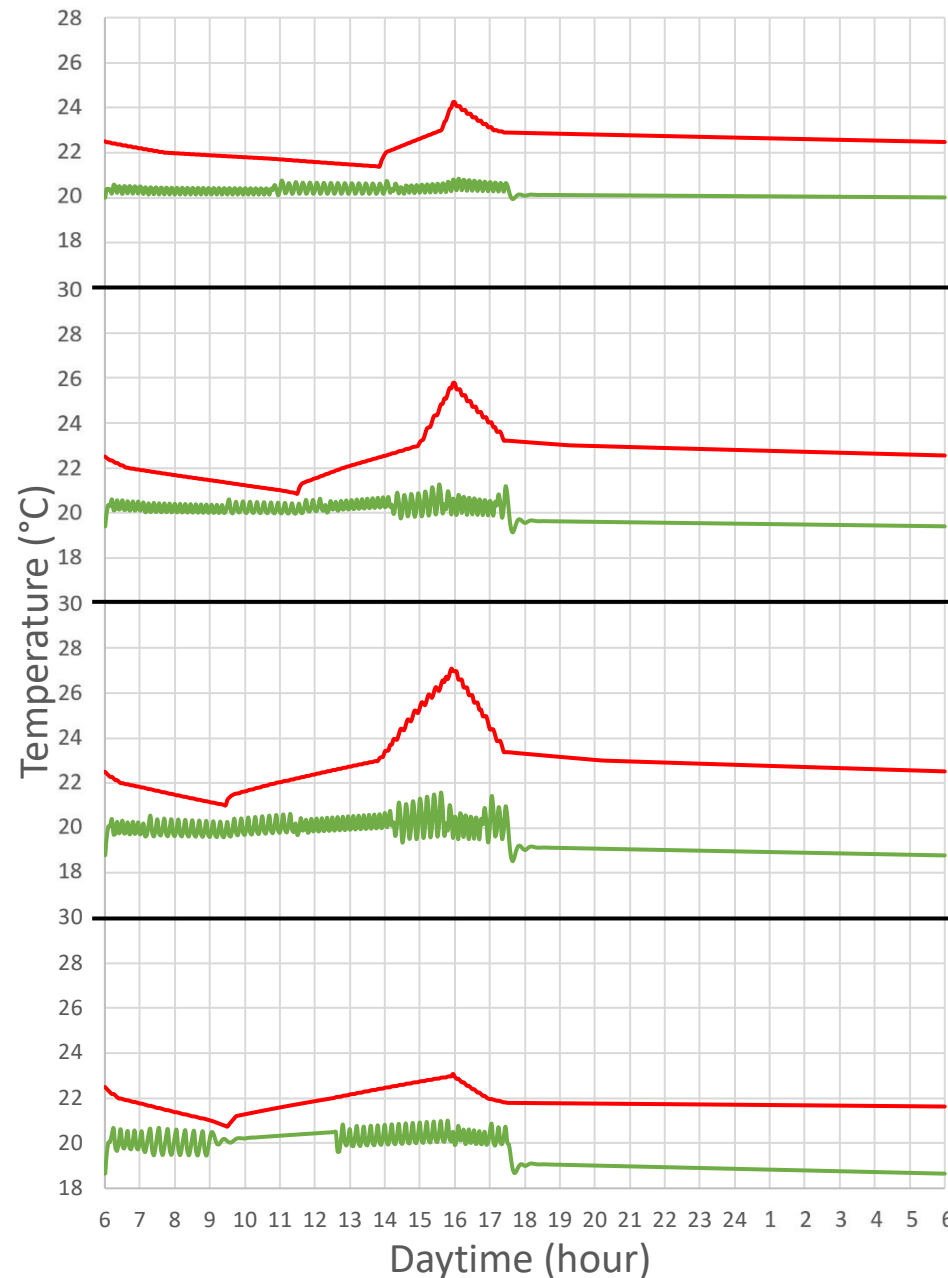

PCM discharge:

- $T_c = 23^\circ\text{C} \rightarrow$ comfort temperature until $T_{\text{ext}} = -10^\circ\text{C}$
- $T_c = 26^\circ\text{C} \rightarrow$ comfort temperature until $T_{\text{ext}} = -5^\circ\text{C}$
- superiority of 23°C PCM due to **lower overnight discharge** than 26°C PCM

Night loading:


Electricity Network → Heat pump: 12KW → PCM



Night loading simulation results

$T_c = 23^\circ\text{C}$

— $T_{\text{PCM board}}$
— $T_{\text{air int}}$

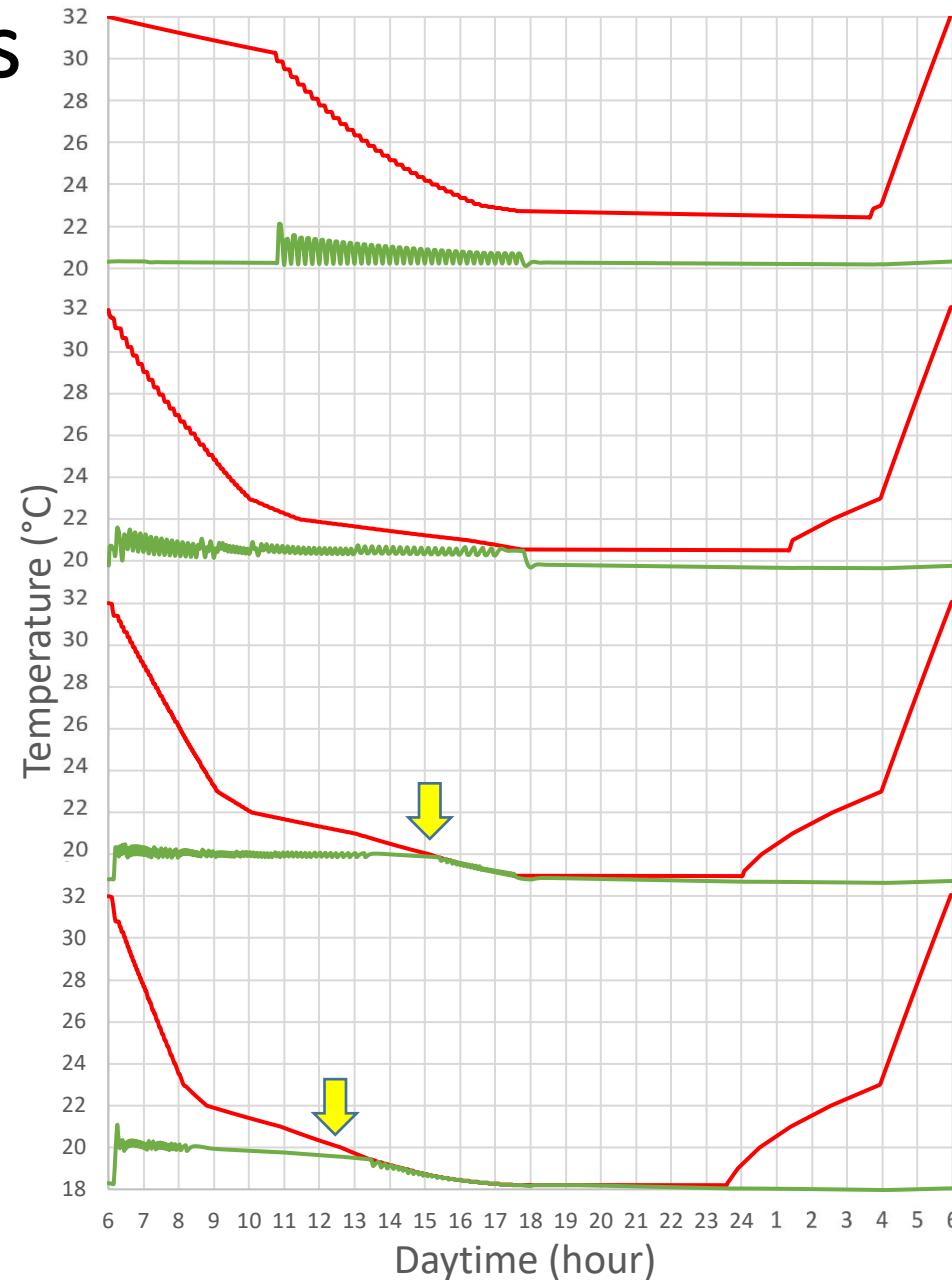


Night loading simulation result

$T_c = 23^\circ\text{C}$

$T_c = 26^\circ\text{C}$

— $T_{\text{PCM board}}$
— $T_{\text{air int}}$

- Both PCM: $T_c = 23^\circ\text{C}$ and $T_c = 26^\circ\text{C}$ allow to maintain comfort temperature until $T_{\text{ext}} = -5^\circ\text{C}$
- Night loading requires a larger storage capacity than day loading due to large time-lag between PCM charge and discharge

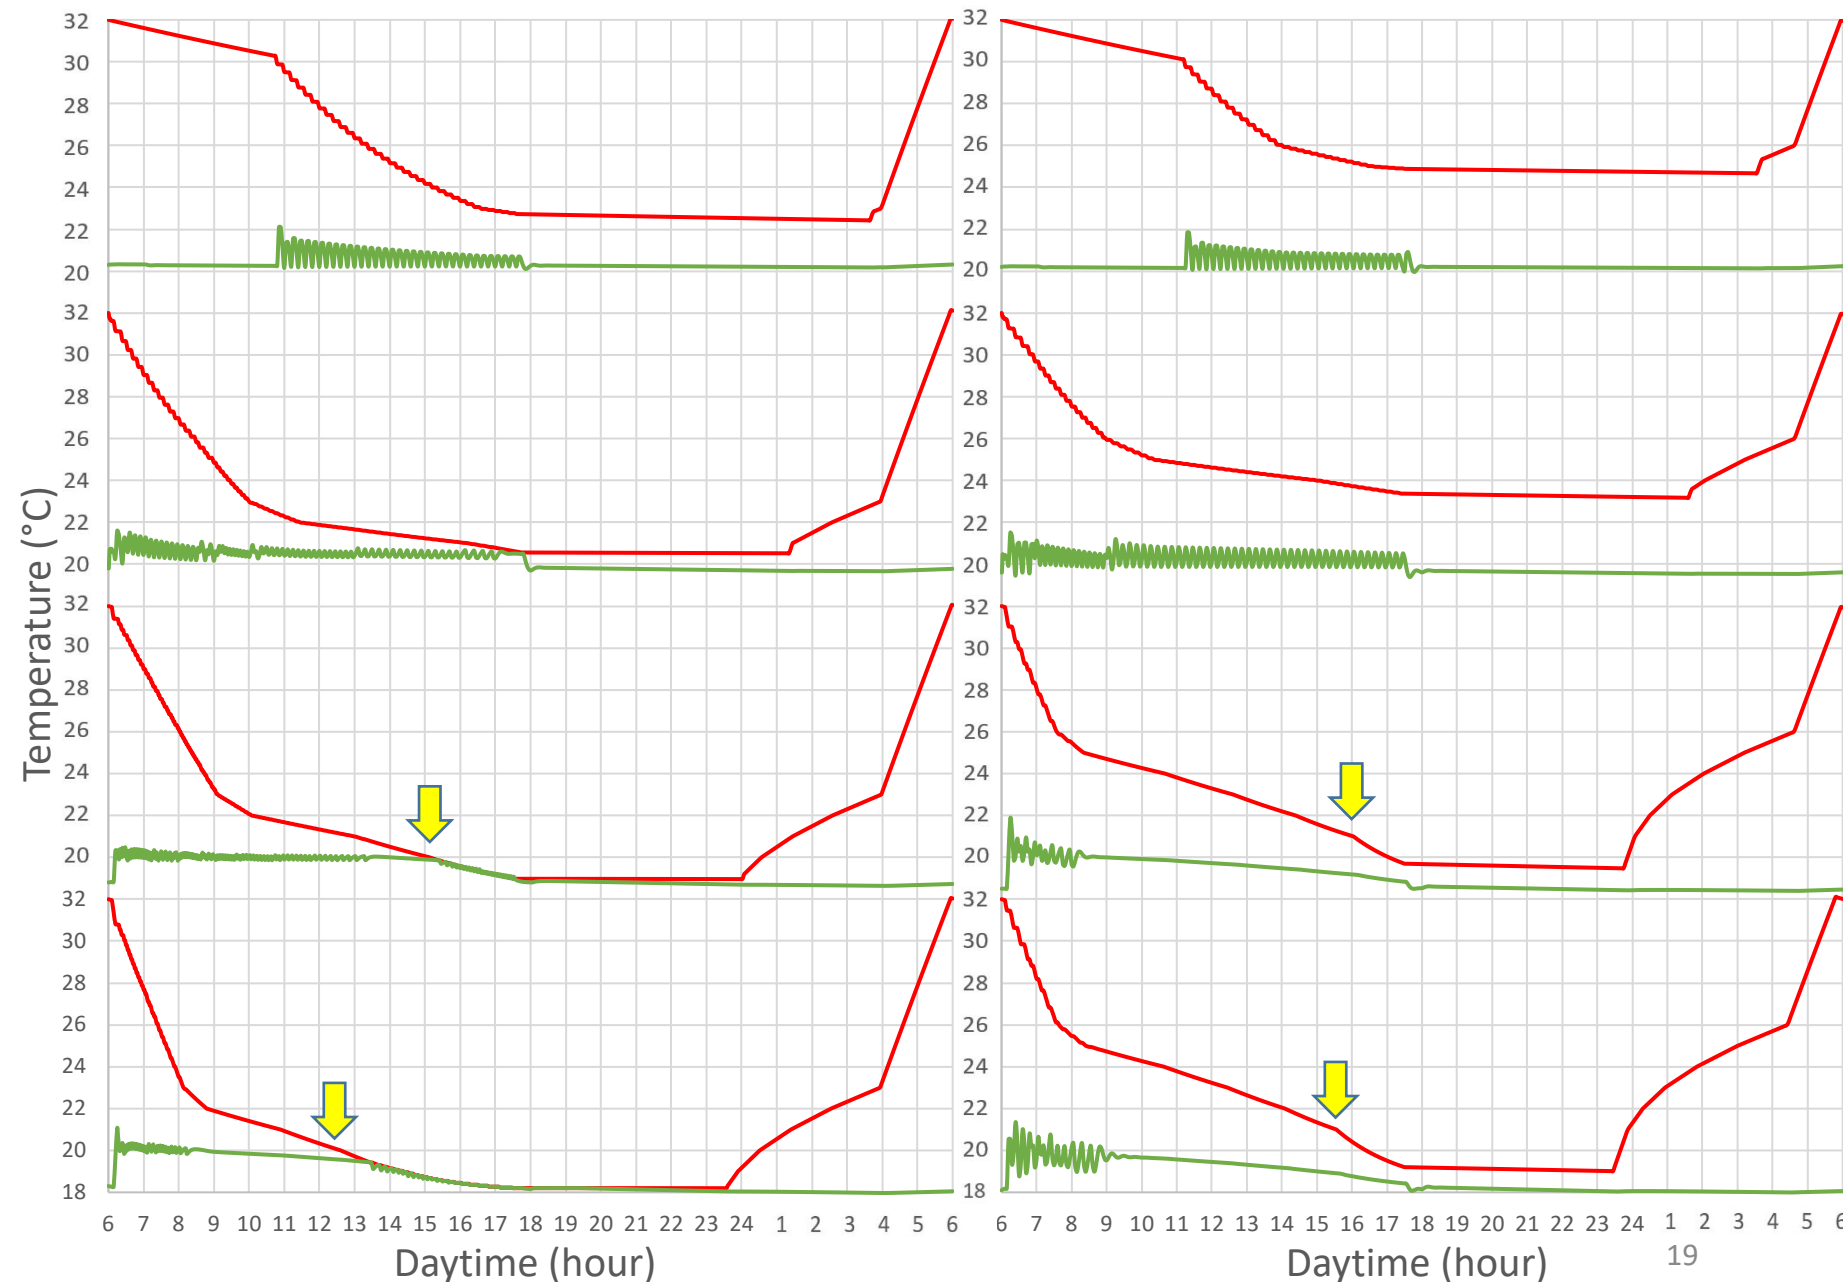


Passive versus active PCM comparison




day loading, $T_{\text{ext}} = 0^\circ\text{C}$

passive PCM 23°C

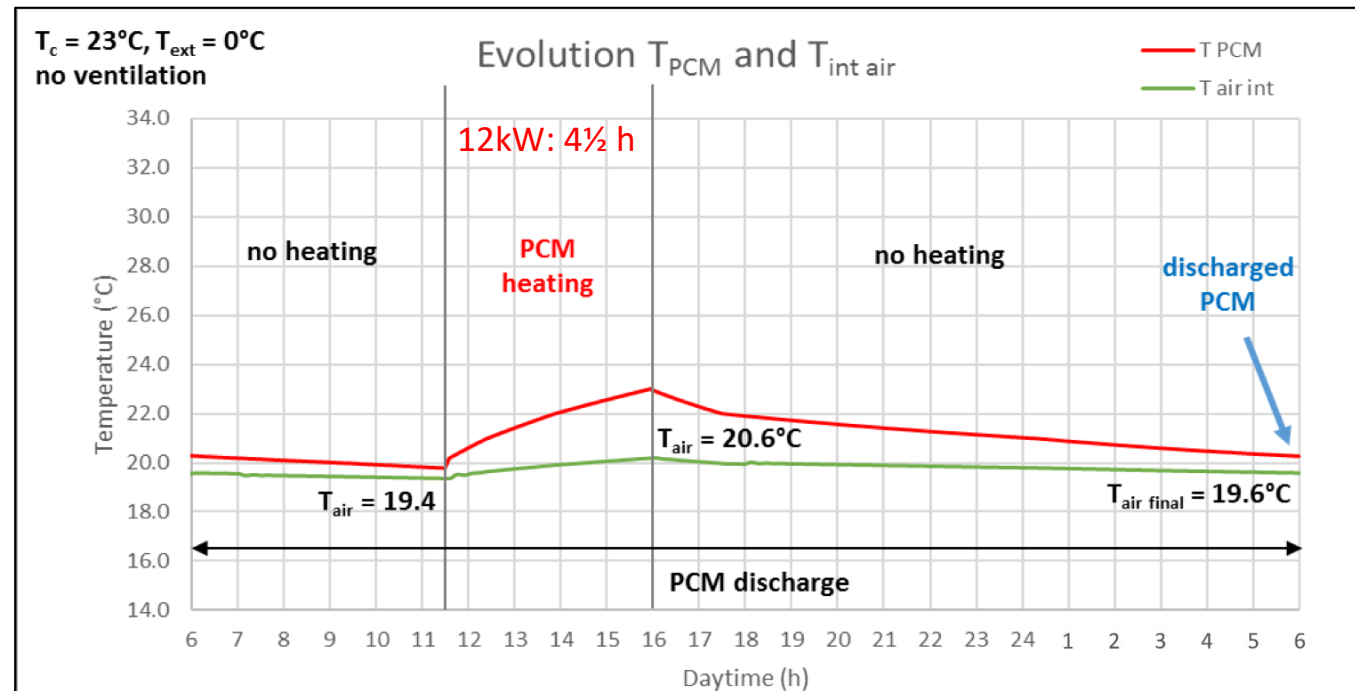

active PCM
 23°C

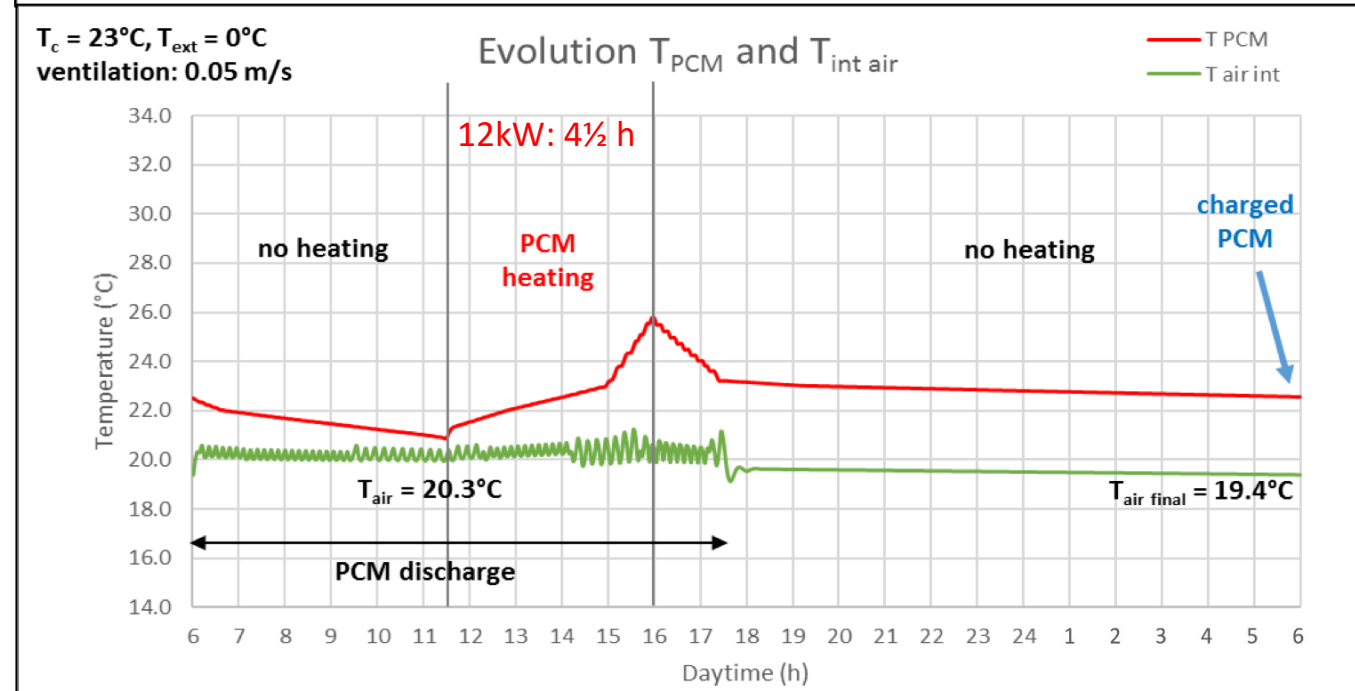

Conclusion

- **Concept of active PCM** walls for heating **validated** by lab tests and simulations:
 - + 5°C in 40mn
 - Studied system suitable for outdoor temperatures between -5°C and +10°C
- **PCM with $T_c = 23^\circ\text{C}$ has higher performances** compared to 26°C (due to lower overnight discharge) but requires ventilation
- **Day loading** requires lower storage capacity than night loading (due to lower heating-loading time-lag)
- **Active PCM has lower heat losses at night time** than passive PCM (continuous natural convection)

PERSPECTIVES and OUTLOOK

- For very cold days: combination of day solar power
+ the necessary night loading defined after weather forecast
- PCM with T_c of 23°C can also provide cooling
- Integration in real building / demonstrator

Thank you for your attention!


Questions?



Back-up slides



Modular elements


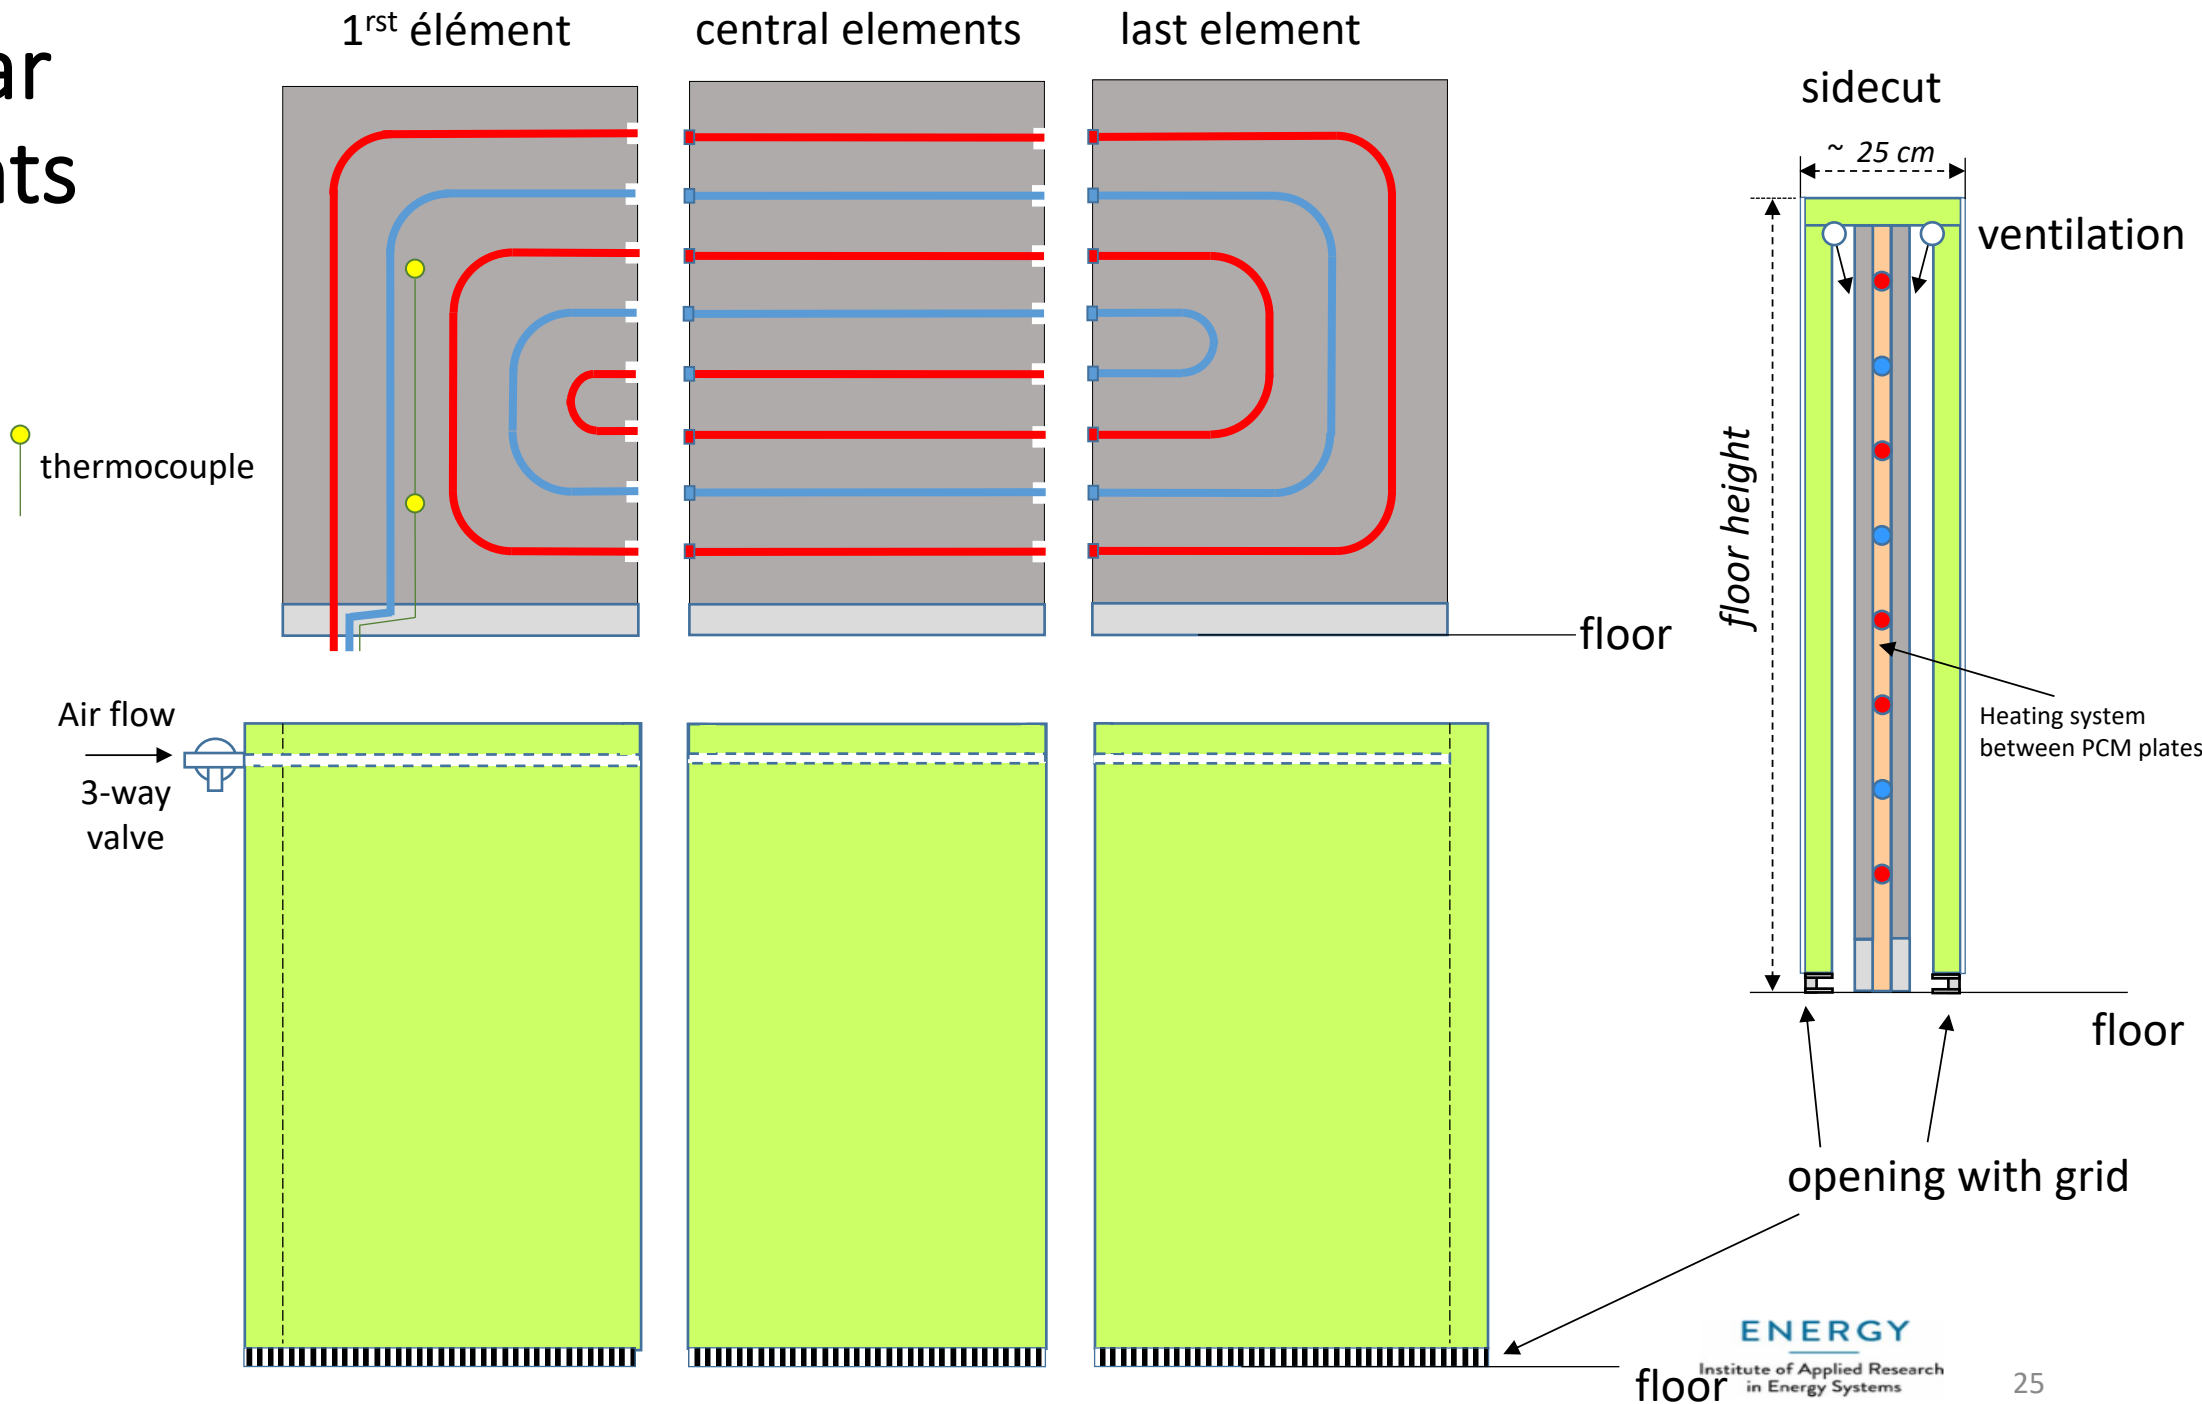


PCM loaded at 06:00 am

/

at 16:00 pm

with latent heat in a single step

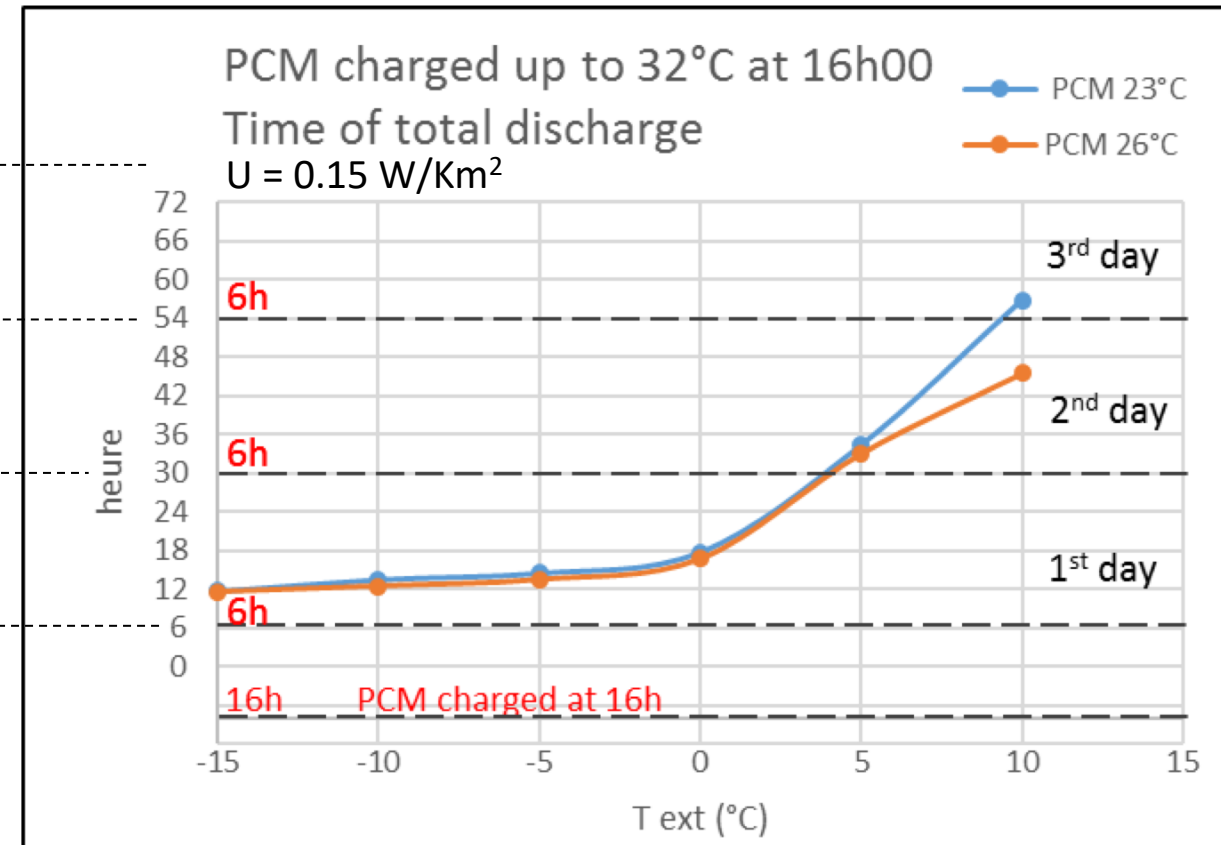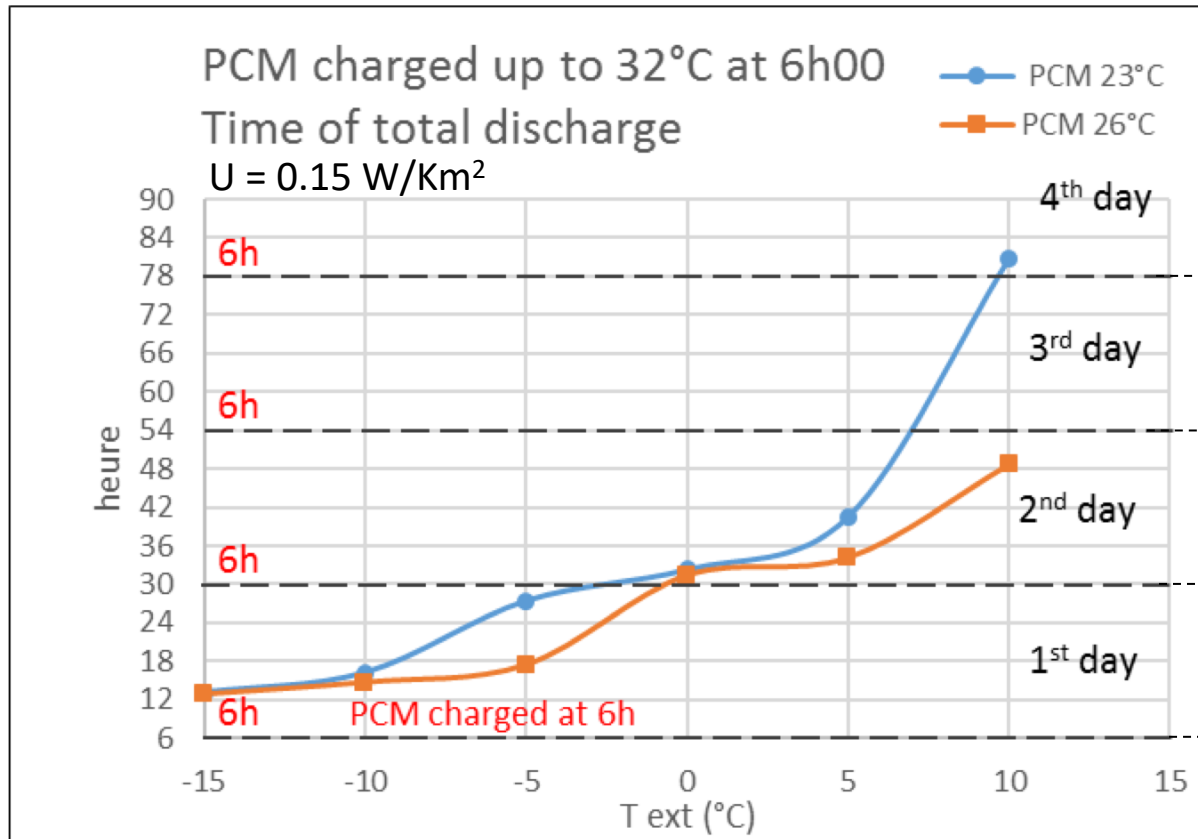

PCM loaded at 06:00 am / at 16:00 pm

